

STATIC WATER PRESSURE: 105 PSI
 Corner of Alessandro Boulevard
 and MISSION GROVE PARKWAY-NORTH
 Source-W.M.W.D. (780-2450)
 Date: August 1987

48 HOURS BEFORE YOU DIG
 CALL
 Underground Service Alert
 1-800-422-4133

SPRINKLER LEGEND

SYMBOL	PART NO.	MANF'R	DESCRIPTION	PSI	RAD.	GPM
▽	1812 SAM PRS RAINBIRD	QUARTER ARC 12" POP-UP SHRUB SPRAY	30	7'	.65	
▽	1812 SAM PRS RAINBIRD	HALF ARC 12" POP-UP SHRUB SPRAY	30	7'	1.30	

CONTRACTOR NOTE: USE B8Q FLT & B8H FLT-0 TRAJECTORY BRASS NOZZLES WITH 1812 SERIES POP-UP BODY - ADJUST ALL HEADS TO 7 FOOT RADIUS. NO OVERTHROW ONTO HARDSCAPE AREAS WILL BE ALLOWED.

SAM - DENOTES SEAL A MATTIC. PRS - DENOTES NEW PRESSURE COMPENSATING SPRINKLER BODY.

□	RC-7	RAINBIRD	AUTOMATIC SPRINKLER CONTROLLER IN "LE MEUR" ENCLOSURE.
□	150 EFA CP	RAIN BD	ELECTRIC REMOTE CONTROL VALVE.
□	33D 3/4"	RAINBIRD	QUICK COUPLER VALVE W/ VINYLE LOCKING COVER VALVE.
□	RPA 200	RAINBIRD	2" REDUCED PRESSURE BACKFLOW PREVENTER WITH GATE VALVES.
□	2001b Class	NIBCO	BRASS BODY RISING STEM GATE VALVE LINE SIZE IN CONC. VALVE BOX.
---	CLASS 200 PVC-IRRIGATION LINE		SLEEVE ALL LINES INSTALLED UNDER CONCRETE.
---	CLASS 315 PVC SUPPLY LINE		

CITY OF RIVERSIDE/UTILITIES

WATER DIVISION	ELECT. DIVISION
NOT APPLICABLE	Charli Blum
date approved	date approved
	16/20/88


WESTERN MUNICIPAL WATER DISTRICT

Approval: [Signature] SHEETS 1 THRU 4

11/23/88

SUPERVISING DESIGN ENGR. DATE

RCE 21643

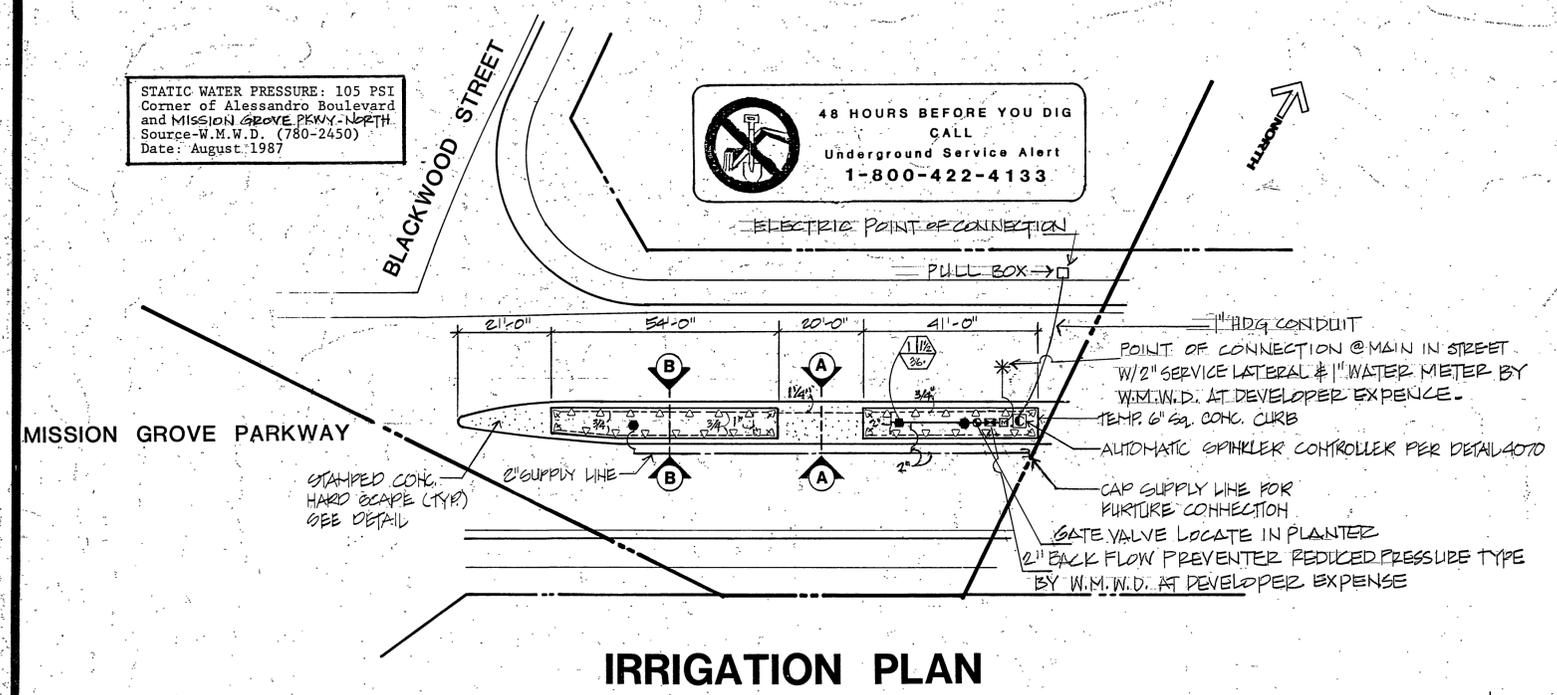

NOTE





IRRIGATION PLAN IS DIAGRAMMATIC DRAWING, WITH SUPPLY LINES SHOWN OVER WALKS AND PAVING. SUPPLY LINES & IRRIGATION LINES SHALL BE INSTALLED PARALLEL AND ADJACENT TO WALKS, WALLS, AND CURBS. LINES SHOWN IN PARKING AREAS TO BE INSTALLED IN PLANTERS. IRRIGATION LINES ACROSS DRIVEWAYS SHALL BE SCHEDULE 40 P.V.C.

COVERAGE TEST:
 UPON COMPLETION OF THE IRRIGATION SYSTEM INSTALLATION, AND PRIOR TO ANY PLANTING THE CONTRACTOR SHALL ADJUST SPRINKLER HEADS TO EVENLY AND PROPERLY DISTRIBUTE THE RATE OF PRECIPITATION OF THE WATER AND SHALL DETERMINE IF THE COVERAGE OF THE PLANTING AREAS IS COMPLETE AND ADEQUATE.


THE CONTRACTOR SHALL FURNISH ALL MATERIALS AND PERFORM ALL WORK REQUIRED TO CORRECT ANY INADEQUACIES OF COVERAGE DISCLOSED BY THE COVERAGE TEST.

CONTRACTOR SHALL FINISH GRADE ALL AREAS TO PROVIDE DRAINAGE OF SURFACE WATER AWAY FROM BUILDINGS TO HARDSCAPE AREAS AND/OR TO THE STREET.

DETAIL

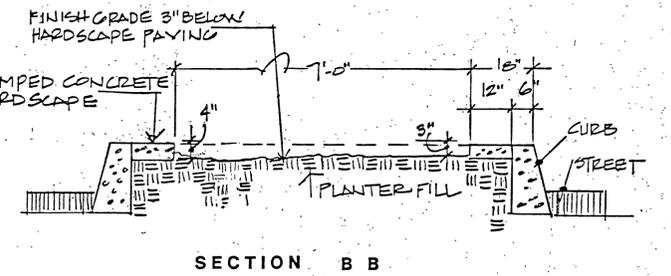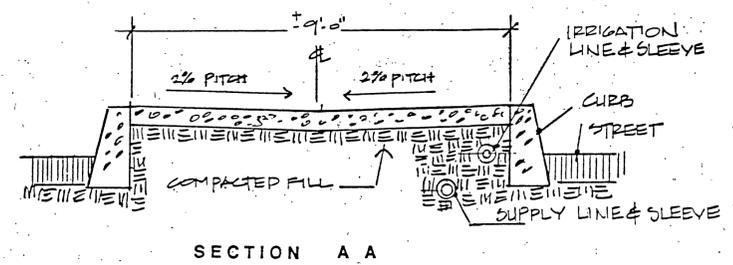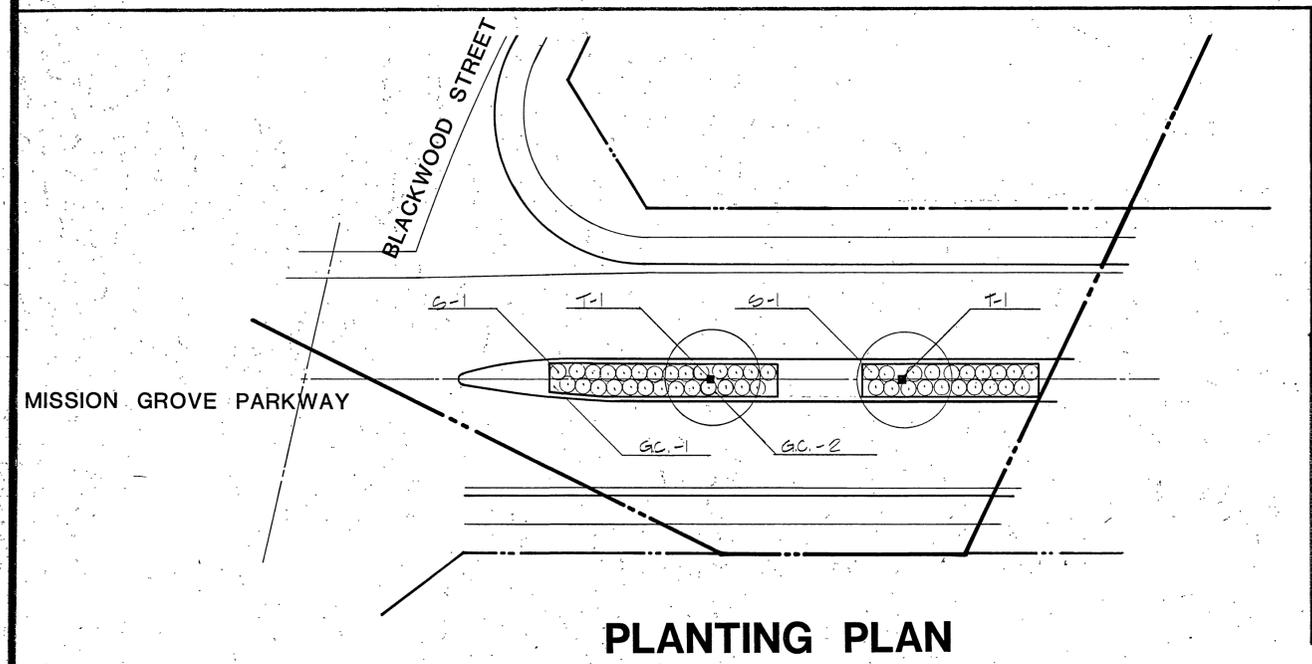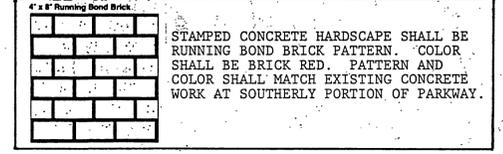

TREE PLANTING DETAIL

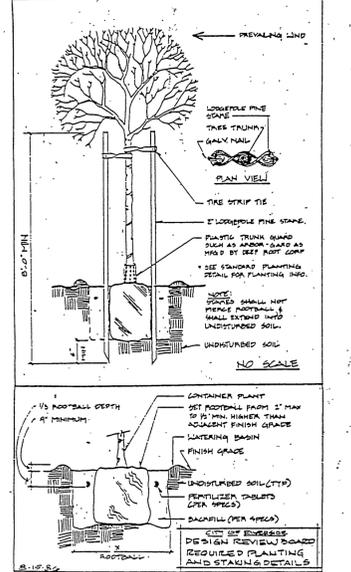

GENERAL NOTES FOR STREET TREE PLANTING

- All related work shall conform to the City of Riverside, Park and Recreation Department standards.
- Contact the Street Tree Inspector a minimum of 48 hours in advance at (714) 351-6126 to schedule inspections. Inspections shall be required: a) when plant locations have been spotted in the field prior to digging plant pits, b) while digging plant pits and planting/relocating trees, c) after planting and all other indicated or specified work has been completed for start of maintenance, and d) at end of maintenance/final acceptance. Contractor/developer will be released from maintenance only upon receipt of written notification from the City that the Park and Recreation Department is assuming maintenance responsibilities.
- The contractor/developer shall maintain all plantings for a minimum period of one (1) year.
- Street Tree planting shall be as follows:

Street Name	Botanical Name	Min. Size	Approx. Spacing	No. Req.

SEE CALL OUTS ON PLANS

NOTE

GENERAL NOTES FOR PROJECT INSPECTIONS

Contact the Parks Projects Inspector at (714) 782-5223 two working days in advance of the following inspections:
 * Before commencing work.
 * When trenching is complete.
 * For pressure test when main line has been installed - 150 psi for not less than 2 hours.
 * Coverage test.
 * When plant pits are dug - before plants are installed.
 * Final inspection at start of maintenance.
 * Final acceptance after 1 year maintenance.

All irrigation and planting must conform to City of Riverside Standard Park & Recreation Specifications.

PLANT LIST

ITEM	SYMBOL	BOTANICAL NAME	COMMON NAME	SIZE	COMMENTS
TREES:	T-1	Platanus acerifolia 'Bloodgood'	London Plane Tree VARIETY 'Bloodgood'	15 GAL.	Stake per City Stds.
SHRUBS:	S-1	Pittosporum tobira 'Wheeleri'	Dwarf Mock Orange	5 GAL.	36" on center Tri-angular spacing.
GROUND COVER:	G-1	Lampranthus aurantiacus 'Sunman'	Gold Flower Bush Ice Plant	FLATS	12" on center Tri-angular spacing.
	G-2		Medium Grind Chipper Mulch		2 inch thick covering in shrub areas only.

DO NOT PLANT GROUND COVER BENEATH SHRUBS - USE CHIPPER MULCH GROUND COVER

OWNER - DEVELOPER
 VAN DAEL DEVELOPMENT CORPORATION
 2900 ADAMS STREET - SUITE C 25
 RIVERSIDE, CALIFORNIA. 92504
 (714) 354-2121



ORTON associates
 landscape development

LICENSE NO. 1214 (714) 985-7000

607 e. seventh st. #1180, Opland, CA 91780

MARK	REVISIONS	APPR. DATE

DESIGNED BY: F.E.C. DRAWN BY: D.R.S. CHECKED BY:

CITY OF RIVERSIDE
 PUBLIC WORKS DEPARTMENT

APPROVED BY	DATE	BY
Principal Engineer	10/20/88	98
Park Department		
Traffic Division		
Chief P.W. Engineer	12-8	12/8

DATE: 12-8-88

TRACT 22212
 MISSION GROVE PARKWAY
 DEVELOPMENT PLAN

HORIZ. SCALE: 1" = 20'
 VERT. SCALE: 1" =

ACCOUNT NO.
R-2970L

SHEET **1** OF **4**

PC-2600

PART 1 - GENERAL

1.01 RELATED DOCUMENTS: The provisions of the "Standard Specifications for Public Works Construction", current edition, shall apply except as modified herein.

1.02 SCOPE: A. General: The work of this section shall include the furnishing of all labor, materials, equipment and services necessary to provide complete operating irrigation system, including 120 volt electrical service to the controller, all as shown on the drawings and as specified.

B. Related Work Specified Elsewhere: Site Clear and Grub 0210 Site Grading 0210 Selected Site Demolition 0211 Planting 02480 Electrical 16530

1.03 SUBMITTALS: A. Materials List: Contractor shall submit a complete materials list for approval by the City prior to performing any work. Catalog data and full descriptive literature must be submitted whenever the use of items different than those specified is requested. Notarized certificate must be submitted by plastic pipe and fitting manufacturer indicating that material complies with specifications, unless material has been previously approved.

Material list shall be submitted using the following format: Table with columns: Item, Description, Manufacturer, Model No. 1 Pressure Supply Line, Lasco, SCH 40, 2 Lawn Head, Rainbird, 2400, etc.

B. "Record" Prints: (1) Record accurately on one set of blue-line prints all changes in the work constituting departures from the original contract drawings, including changes in pressure and non-pressure line locations.

(2) The changes and dimensions shall be recorded in a legible and workmanlike manner to the satisfaction of the City. Prior to final inspection of work, submit record prints to City for approval.

(3) Dimension from two permanent points of reference (buildings, monuments, sidewalks, curbs, pavement, etc.) Data to be shown on record prints shall be recorded day-to-day as the project is being installed.

- (4) Show locations and depths of the following items: a. Point of connection. b. Routing of sprinkler pressure lines (dimension maximum 100 feet along routing). c. Gate valves. d. Sprinkler control valves. e. Quick coupling valves. f. Routing of control wires. g. Related equipment (as may be directed).

(5) Maintain record prints onsite at all times.

1.04 INSPECTIONS: A. Inspections will be required for: (1) Pressure test of irrigation main line. (2) Coverage test. (3) Final inspection/start of maintenance. (4) Final acceptance.

B. Inspection Requests: Material list notify the Park Projects Inspector in advance for requesting all inspections as follows: Pressure supply line installation and testing - 36 hours (1-1/2 working days) System layout - 36 hours (1-1/2 working days) Coverage test - 36 hours (1-1/2 working days) Final inspection - 48 hours (two working days)

C. Closing in uninspected work: Do not allow or cause any of the work of this section to be covered up or enclosed until it has been inspected, tested and approved by the City.

D. Coverage test: When the sprinkler system is completed, Contractor shall perform a coverage test in the presence of the City to determine if the water coverage for planting areas is complete and adequate. This test must be accepted by the City before planting can commence.

E. Hydrostatic test: (1) Prior to the installation of any valves, all pressure lines shall be tested under a hydrostatic pressure of 150 psi for a period of not less than two hours, with all ends of lines capped and the line fully charged with water after all air has been expelled from the line. (2) All hydrostatic tests shall be made in the presence of the City. No pressure line shall be backfilled until it has been inspected, tested, approved in writing, and the mainline and valve locations have been noted on the "as-built" record drawings. (3) Contractor shall furnish necessary force pump and all other test equipment.

1.05 TURNOVER ITEMS:

A. Controller Charts: (1) Record prints must be approved by City before charts are prepared. (2) Provide one controller chart (of the maximum size controller door will allow) for each automatic controller. Chart shall show the area covered by controller. (3) The chart is to be a reduced copy of the actual "record" print. In the event the controller sequence is not legible in the print it reduced, it shall be enlarged to a readable size. (4) Chart shall be marked with a different color to show the area of coverage for each station. (5) When completed and approved, the chart shall be hermetically sealed between two pieces of plastic, each piece being minimum 20 mils in thickness. Chart shall be installed in the controller enclosure using velcro fasteners. (6) Controller charts shall be completed prior to final inspection.

B. Operation and Maintenance Manuals: Within 10 calendar days prior to acceptance of construction, prepare and deliver to the City all required descriptive materials, properly prepared in two individually bound copies of the operation and maintenance manual. The manual shall describe the material installed and shall be in sufficient detail to permit operating personnel to identify, operate, and maintain all equipment. Spare parts lists and related manufacturer's information shall be included for each equipment item installed. Each complete, bound manual shall include the following information: (1) Index sheet stating Contractor's address and telephone number, including names and addresses and telephone numbers of local manufacturer's representatives. (2) Complete operating and maintenance instructions on all major equipment.

C. Materials to be furnished: (1) Supply as part of this contract the following items: a. 45 additional sprinkler heads of each type and spray pattern shown. b. (2) wrenches for disassembly and adjustment of each type sprinkler head installed. c. Two keys for each automatic controller. d. Two couplers with a 3/4" bronze hose bit, bent nose type with hand wheel and two coupler keys. e. One valve box cover key. f. "As-built" record drawings. g. Remove and turn over backflow device valve handles. h. Documentation of Water Department's inspection and acceptance of backflow device. D. The above items shall be turned over to the City at the conclusion of the project - final inspection.

1.06 GUARANTEE: A. General: The entire sprinkler system, including all work done under this contract, shall be guaranteed against all defects and fault of material and workmanship for a period of one (1) year following the filing of the Notice of Completion. All materials used shall carry a manufacturer's guarantee of one (1) year.

B. Form of Guarantee: Guarantee shall be submitted on Contractors own letterhead as follows: GUARANTEE FOR SPRINKLER IRRIGATION SYSTEM We hereby guarantee that the sprinkler irrigation system we have furnished and installed is free from defects in materials and workmanship, and the work has been completed in accordance with the drawings and specifications, ordinary wear and tear and unusual abuse, or neglect excepted, and that the work, materials, and equipment as installed will fulfill the requirements of the guarantee included in the specifications. We agree to repair or replace any or all of our work, together with any other adjacent work which may be displaced by so doing, and equipment as determined by the City constitute an emergency (e.g. broken pressure line) the City may proceed to make repairs at the Contractor's expense. Any and all damages to existing improvement resulting either from faulty materials or workmanship, shall be repaired to the satisfaction of the City by the Contractor, all at no additional cost to the City.

C. After the system has been completed, the Contractor shall instruct the Parks Department Representative in the operation and maintenance of the system and shall furnish a complete set of operating instructions. D. Any settling of trenches which may occur during the one-year period following acceptance shall be repaired to City's satisfaction by the Contractor without any additional expense to the City. Repairs shall include the complete restoration of all damage to planting, paving or other improvements of any kind as a result of the work.

PART 2 - MATERIALS 2.01 GENERAL: All materials shall conform with Section 212 of the Standard Specification except as modified herein. 2.02 PIPE AND FITTINGS: A. Pipe - General: (1) Pressure supply lines 2 inches in diameter and up to 8 inches in diameter shall be either Class 315 solvent weld PVC or Class 200 rubber gasket type PVC. Solvent weld and ring type pipe shall not be used together on the same pressure supply line. (2) Pressure supply lines 1-1/2 inches in diameter and smaller shall be minimum schedule 40 PVC. (3) Non-pressure lines shall be minimum Class 200 PVC.

B. Steel Pipe: Amend Standard Specifications Section 212-2.1.2 to read: "All steel pipe shall be hot-dipped galvanized, ... and add: "All fittings for steel pipe shall be 250 pound rated galvanized malleable iron, bonded pattern. Pipe sizes indicated on the drawings are nominal inside diameter, unless otherwise noted." C. Plastic Pipe: Add the following to Standard Specifications Section 212-2.1.3: All plastic pipe shall bear the following markings: manufacturer's name, nominal pipe size, schedule or class, type of material, pressure rating in PSI, NSF seal of approval, and date of extrusion. Amend Standard Specification Section 212-2.1.3 to read: All plastic pipe fittings shall be standard weight schedule 40 and shall be injection molded of an improved PVC fitting compound. All threaded plastic fittings shall have injection molded threads. All cut threads will be accepted on PVC pipe and fittings. All tee and elbow shall be manufactured in injection molds that are side gated. All threaded nipples shall be standard weight schedule 40 with molded threads.

Amend first sentence of Standard Specification Section 212-2.1.4 to read: "All rubber gasket PVC pipe, couplings, and fittings shall conform to ASTM D 2241 Type 1, Grade 1, 2000-PSI design stress"; and add the following to the section: "Couplings, rubber gaskets, and fittings shall be as approved by the pipe manufacturer. Ring-type rubber gasket couplings shall permit a five (5) degree deflection of the pipe at each coupling (2-1/2 degrees each side) without extrusion or infiltration, cracking or breaking."

D. Asbestos Cement Pipe: Add the following to Standard Specifications Section 212-2.1.6: Fittings for A.C.P. connections laterals shall be cast iron tees and bossed couplings except as follows: (1) Double strap service clamps with rubber seals and flat bronze straps may be used for connections of 50 percent or less than the diameter of pipe. (2) Tapped A.C.P. couplings with brass inserts may be used for connections of 3/4, 1, 1-1/4, 1-1/2 and 2 inches.

2.03 VALVES AND VALVE BOXES: A. Manual Control Valves: Add the following to Standard Specifications Section 212-2.2.3: Anti-siphon-type valves - shall be all bronze with swivel-type replaceable seating members and an approved vacuum breaker as an integral part of assembly. B. Remote Control Valves: Add the following to Standard Specifications Section 212-2.2.4: Valves shall be spring-loaded, self-cleaning, packless diaphragm activated, of a normally closed type. Valves shall be of the same manufacturer and series as the automatic controller. Valve solenoid shall be corrosion-proof and constructed of stainless steel molded in epoxy to form one integral unit, and shall be 24 volt A.C., 2.0 watt maximum (2" and smaller valves). Valve shall close against flow without chatter and with minimum closing surge pressure (minimum 5 seconds closing time per valve). Valve shall be completely serviceable in the field without removing valve body from line.

C. Quick-Coupling Valves: Add the following to Standard Specifications Section 212-2.2.6: Quick coupling valves shall have locking vinyl cover and shall be 1" in size. D. Gate Valves: All gate valves shall be capable of withstanding a minimum working pressure of not less than 150 psi. E. Valve Boxes: Add the following to Standard Specifications Section 212-2.2.7: All remote control valve boxes shall be rectangular concrete boxes with non-hinged locking cast-iron covers. Valve station number shall be stenciled in two-inch high 121 numerals on cover using epoxy resin base paint of a contrasting color. Gate valve boxes shall be round concrete boxes with non-hinged locking cast-iron covers marked either "Gate Valve" or "G.V." with letters cast or toled in the cover.

2.04 BACKFLOW PREVENTER: Add the following to Standard Specifications Section 212-2.3: The backflow prevention unit shall be a reduced pressure type vacuum breaker of the size, manufacture, and model number as indicated on the drawings. If not indicated, the device shall be the same size as the water service and the manufacturer and model number shall be as approved by the City. 2.05 ELECTRICAL MATERIALS: A. Conduit: Amend Standard Specifications Section 212-3.2.1 to read: Conduit for low voltage shall be schedule 40 PVC of sufficient size to carry all proposed wiring. Wiring shall be in a separate sleeve. B. Wire: Add the following to Standard Specifications Section 212-3.2.2: All common wire shall be white with a colored stripe. Stripe color shall be different for each controller installed. All control wire shall be of one color other than white or green. A different color control wire shall be used for each controller installed.

C. Electrical Service: Materials for electrical service shall comply with the standard specifications, governing utility agency standards, and requirements of all applicable codes. 2.06 CONTROLLER UNIT: Add the following to Standard Specifications Section 212-3.3: Controllers shall be well mounted type, as indicated on the drawings, with a heavy duty watertight case and locking cover. 2.07 IRRIGATION HEADS: All irrigation heads shall be as shown on the plans and shall conform with Section 212-2.4 of the Standard Specifications.

PART 3 - EXECUTION 3.01 GENERAL: All work shall conform with Section 308 of the Standard Specifications except as modified herein. No work of this section other than sleeving under pavement shall commence prior to the completion and acceptance of all grading work specified in Section 0210. Add the following to Standard Specifications Section 308-5.1: A. Water Supply: Connections to or the installation of the water supply shall be at the locations shown on the drawings. Minor changes caused by actual site conditions shall be made at no additional cost to the City. B. Electrical Service: Contractor shall provide electrical service as necessary and make 120V connection to the irrigation controllers. C. Code Requirements: Prior to all work of this section, carefully inspect the installed work of all other trades and verify that all such work is complete to the point where this installation may properly commence. Verify that irrigation system may be installed in strict accordance with all pertinent codes and regulations, the original design, the referenced standards, and the manufacturer's recommendations. D. Grades: Before starting work of this section, the contractor shall obtain the written acceptance of the City of the final grade, and written authorization for the work of this section to proceed. Contractor is to keep within the specified material depths with respect to finish grade. Failure to obtain such written acceptance may subject the contractor to adjusting the grades or depth of lines in order to achieve acceptable depths of cover, all as directed by the City and at no additional cost to the City. E. Coordination with work of other trades: Make all necessary measurements in the field to ensure precise fit of items in accordance the original design. Contractor shall coordinate the installation of all irrigation materials with all other work. Special attention shall be given to coordination of piping locations versus trees and shrub locations and sleeve locations versus pavement installation to avoid conflicts. F. Contractor shall maintain record drawing blueprint on site at all times. Upon completion of work, transfer all as-built information on changes and dimensions to reproducible copy prints. The changes and dimensions shall be recorded in a legible and workmanlike manner, to the satisfaction of the Park Projects Inspector.

3.02 TRENCHING AND BACKFILLING: A. Trenching: Add the following to Standard Specifications Section 308-2.2: Dig trenches and support pipe continuously on bottom of ditch. Where lines occur under paved areas, depth dimensions shall be considered below subgrade. (2) Amend Standard Specifications Section 308-2.2.2 to read: Water lines continuously pressurized - minimum 18 inches, maximum 24 inches. (These measurements are to be from subgrade elevation for piping under pavement. 2) Amend Standard Specifications Section 308-2.2, paragraph 3) to read: Lateral sprinkler lines - minimum 12 inches and maximum 16 inches. (4) Add the following to Standard Specifications Section 308-2.2: Where it is necessary to excavate adjacent to existing trees, the contractor shall avoid injury to trees and tree roots. Excavation in areas where 2-inch and larger roots occur shall be done by hand. All roots 2 inches and larger in diameter shall be tunneled under and shall be heavily wrapped with wet burlap to prevent scarring or drying. Where trenching machine is run close to trees having roots smaller than 2 inches in diameter, the wall of the trench adjacent to the tree shall be hand trimmed, making a clean cut through the roots. Roots 1 inch and larger in diameter shall be painted with two coats of tree seal or approved equal. Trenches adjacent to trees shall be closed within 24 hours. (5) Permanent Resurfacing: Add the following to Standard Specifications Section 308-5.1: All surface improvements damaged or removed as a result of the contractor's operations shall be reconstructed by the contractor to the same dimensions, except for pavement thickness, and with the same type materials used in the original work. Trench resurfacing shall be 1 inch greater in thickness than existing pavement. Concrete pavement shall be removed and replaced in "full panels" with no horizontal dimension less than five (5) feet. Contractor shall review the planned limits and lines of concrete removal and replacement with the Park Projects Inspector prior to sawcutting for removal work.

B. Backfill: Amend Standard Specifications Section 308-2.2 to read: Backfill shall be uniformly tamped in 4-inch layers under and around the pipe for the full width of the trench and the full length of the pipe. Materials shall be sufficiently damp to permit thorough compaction. Free of voids. Backfill shall be compacted to dry density equal to adjacent undisturbed soil and shall conform to adjacent grades. Flooding in lieu of tamping is not allowed without specific prior written approval of the Soils Engineer and the Park Projects Inspector. Under no circumstances shall the wheels of any vehicle not designed for the purpose of soils compaction be used to compact backfill.

3.03 PIPE INSTALLATION: A. General: Add the following to Standard Specifications Section 308-5.2.1: (1) Piping under existing pavement may be installed by jacking, boring, or hydraulic driving. However, no hydraulic driving is permitted under asphaltic concrete pavement. (2) Cutting or breaking of existing pavement is not permitted except as approved by Park Projects Inspector. When approved, all necessary repairs and replacements will be made at no additional cost to the City. (3) Carefully inspect all pipe and fittings before installation, removing all dirt, scale and burrs and rounding; install pipe with all markings up for visual inspection and verification. (4) Contractor shall install concrete thrust blocking per the manufacturer's recommendations at all changes of direction and terminal points of pressure pipe. (5) Parallel lines shall not be installed directly over one another. Provide a minimum of 12" horizontal separation for all parallel lines. (6) For plastic-to-metal connections, work the metal connections first. Use a non-hardening pipe dope on all threaded plastic-to-metal connections, except where noted otherwise. (7) All piping under pavement shall be sleeved using schedule 40 PVC sleeves. Each line shall be separately sleeved. (8) Do not install multiple assemblies ("manifold") on plastic lines. Provide each equipment assembly (e.g. RCV, quick coupler gate valve, head, backflow device) with its own connection to its service line. B. Plastic Pipe: Add the following to Standard Specifications Section 308-5.2.3: (1) Exercise care in handling, loading, unloading and storing plastic pipe and fittings, store plastic pipe and fittings under cover until ready to install; transport plastic pipe on a vehicle with a bed long enough to allow pipe to lay flat, avoid undue bending and any concentrated external load. (2) 360° applicators shall be used to apply primer and solvent on pipe sizes 2-1/2 inches and larger.

3.04 BACKFLOW INSTALLATION: Add the following to Standard Specifications Section 308-5.3: Install backflow assemblies at locations approved in the field by the Park Projects Inspector and at heights required by local codes. 3.05 VALVE AND VALVE BOX INSTALLATION: Amend Standard Specifications Section 308-5.3 to read: Valves shall be the same size as the pipeline in which they are installed unless otherwise specified on plans. Valves shall be installed a minimum of three feet horizontal distance apart, each with its own connection to the pressure main line. Amend Standard Specifications Section 308-5.3 to read: Install quick couplers and valve boxes per Parks and Recreation department standard details. Add the following to Standard Specifications Section 308-5.3: Valves shall be installed in shrub areas whenever possible. No valves or valve boxes other than quick coupler valves shall be installed within a designated athletic playing field. 3.06 SPRINKLER HEAD INSTALLATION: Amend Standard Specifications Section 308-5.4.1 to read: Sprinkler heads shall be installed as designated on the drawings and per Parks and Recreation standard details. 3.07 CONTROLLER INSTALLATION: Add the following to Standard Specifications Section 308-5.5: The controller location, as shown on the plans, is diagrammatic. The final location of the controller shall be as approved by the Park Projects Inspector before installation. The Contractor shall coordinate the electrical service with this location. The controller shall be well mounted within a Leeward resistant enclosure, unless noted otherwise on the plan. Controller enclosure shall be located in shrub areas and/or adjacent to other hardscape items. Enclosure shall be painted with two coats of white color approved substrate paint. A 4" brick concrete slab for maintenance access shall be provided, size approximately 15 sq. ft., line, grade and dimensions as directed by the Park Projects Inspector. Following establishment of the turf, the irrigation system shall be programmed to operate during the periods of minimal use of the project area (i.e., 11:00 p.m. through 6:00 a.m.). 3.08 WIRING: Add the following to Standard Specifications Section 308-5.5: All splice connections shall occur in a valve box. All wire runs between the valve and the controller shall be a continuous run with no splices unless noted otherwise on the plan. All low voltage wiring splices shall be made-up as soldered connections, wrapped with a minimum of two (2) layers of electrical tape and sealed with Scotch-coat. Scotch-lok, Uni-pack, Penn-tite, or other similar type connectors are not acceptable.

3.09 FINISHING AND TESTING: Add the following to Standard Specifications Section 308-5.6.2: Centerload all plastic pipe prior to pressure testing. Amend Standard Specifications Section 308-5.6.2 to read: Pressure test the main - minimum 2 hours at 150 PSI. Add the following to Standard Specifications Section 308-5.6.2: The entire system shall be operating properly before any planting operations commence. 3.10 COMPLETION CLEANING: Add the following to Standard Specifications Section 308: Upon completion of the work, Contractor shall smooth all ground surfaces, remove excess materials, rubbish, debris, etc., sweep adjacent streets, curbs, gutters, walkways and trails, and remove construction equipment from the premises. END OF SECTION

BJ/0017/c 05/12/87

REVERSE FRONTAGE GENERAL NOTES FOR PLAN CHECK 1. All related work shall conform to the City of Riverside Park and Recreation Department Standards. 2. Contact the Park Projects Inspector a minimum of 48 hours in advance at (714) 782-5223 to schedule inspection. Inspections shall be required: a. Prior to the installation of irrigation lines of components. b. Prior to installation of hardscape. c. When plant locations have been spotted if the field prior to digging plant pits. d. While digging plant pits and planting/relocating trees. e. After planting and all other indicated or specified work has been completed for start of maintenance. f. At end of maintenance/final acceptance (contractor/developer will be released from maintenance only upon receipt of written notification from the City that the Park and Recreation Department is assuming maintenance responsibilities). 3. The Contractor/Developer shall maintain all plantings for a minimum period of one (1) year.

NOTE: + ALL WIRES UNDER CONCRETE SHALL BE SLEEVED PER CITY OF RIVERSIDE PARK AND RECREATION DEPARTMENT STANDARDS. + ALL PIPING UNDER CONCRETE SHALL BE SEPARATELY SLEEVED PER CITY OF RIVERSIDE - PARK AND RECREATION DEPARTMENT STANDARDS.

ORTON associates landscape development LICENSE NO 1214 (714) 985-7000 607 e. seventh st. • upland • ca 91788



CITY OF RIVERSIDE PUBLIC WORKS DEPARTMENT APPROVED BY DATE BY APPROVED BY DATE BY PUBLIC WORKS DIRECTOR

SPECIFICATION SHEET MISSION GROVE PARKWAY FOR TRACT 22212 ACCOUNT NO. R-2970L SHEET 2 OF 4

PC-2600

INDEXED 11-89

SECTION 02480 - PLANTING

PART 1 - GENERAL

1.01 RELATED DOCUMENTS:

The provisions of the Standard Specifications for Public Works Construction shall apply except as modified herein.

1.02 SCOPE:

The work required is indicated on the drawings and includes, but is not necessarily limited to: soil preparation; finish grading (as distinguished from fine grading per Section 02210); planting trees; guying and staking trees; planting shrubs and groundcover; hydroseeding turf; soil erosion control; maintenance; plant establishment; guarantee; and replacements.

1.03 SOILS TEST:

The Contractor shall notify the Park Projects Inspector upon completion of fine grading and prior to commencement of soil preparation work. The City will obtain agronomic soils tests for all planting areas after completion of fine grading and prior to start of soil preparation work. Tests will be performed by an approved agronomic soils testing laboratory and will include a fertility and suitability analysis with written recommendations for soil preparation, planting backfill mix, auger hole requirements, and post plant fertilization program. The soils report recommendations shall take precedence over the minimum amendment and fertilizer application rates specified herein only when they exceed the specified minimums. Contractor shall allow a minimum two week period for the soils testing work commencing upon acceptance of the fine grading work per Section 02210 by the Park Projects Inspector.

1.04 GUARANTEE:

- A. All trees installed under the contract shall be guaranteed against any and all poor, inadequate or inferior materials and/or workmanship for a period of one (1) year following final acceptance.
B. During the guarantee period, any material found to be dead, missing or in poor condition shall be replaced by the contractor within ten (10) days of written notification.
C. Replacement shall be made in accordance with City standards.
D. Material and labor involved in replacing plant material shall be provided by the contractor at no additional cost to the City.

1.05 INSPECTIONS:

- A. Upon completion of fine grading and prior to commencement of soil preparation, for acceptance of fine grading work and taking of soils samples.
B. Inspection of completed finish grading work following soil amendment work.
C. When container plants and/or bare root stock are spotted for planting, but before planting holes are excavated.
D. When planting and all other indicated or specified work has been completed.
E. During application of pre-emergent chemical.
F. At start of plant establishment period.
G. At end of the plant establishment period, prior to final acceptance of the project for maintenance by the City, this acceptance for maintenance will be confirmed in writing by the Parks and Recreation Department.

1.06 SUBMITTALS:

- A. The following written certifications are required to be submitted to the Park Projects Inspector upon delivery of the respective materials to the job site:
Total Quantity of commercial fertilizers, by type
Total Quantity of soil amendments and conditioners, by type
Total Quantity of seed, by type
Total Quantity of mulch
Total Quantity of iron sulphate

1.07 PLANT ESTABLISHMENT PERIOD:

The length of the Plant Establishment Period shall be as specified in Section 7-7.4 of the Special Provisions; see also Subsection 3.08 of this section regarding start of plant establishment period.

PART 2 - MATERIALS

2.01 GENERAL:

All materials shall conform with Section 212 of the Standard Specifications except as modified herein.

2.02 FERTILIZER, SOIL AMENDMENTS AND CONDITIONERS:

- A. Add the following to Standard Specifications Section 212-1.2.3:
Planting Tablets: Lightly compressed long-lasting, slow-release fertilizer tablets weighing 21 grams, with a potential acidity of not more than 5 percent by weight and having an analysis of 20-10-5 derived from the sources listed in the following guaranteed analysis:
GUARANTEED ANALYSIS
Total Nitrogen (N) 20%
Derived from urea formaldehyde
7.0% water soluble nitrogen
13.0% water insoluble nitrogen
Available Phosphoric Acid (P2O5) 10%
Derived from calcium phosphate
Soluble Potash (K2O) 5%
Combined Calcium (Ca) 2.6%
Derived from calcium phosphates
Combined Sulfur (S) 1.6%
Derived from ferrous and potassium sulfates
Iron (expressed as elemental Fe) 35%
Derived from ferrous sulfate
B. Commercial fertilizer shall bear the manufacturer's guaranteed statement of analysis and shall meet the following minimum requirements: 16% nitrogen, 6% phosphoric acid, and 8% potash.
C. Organic Soil Amendment:
Shall be type 1 organic soil amendment, wood based product, nitrogen stabilized.
D. Soil Conditioners:
Add to Standard Specifications, new Section 212-1.2.6: Inorganic conditioners shall be agricultural grade gypsum, soil sulfur and iron sulfate. Iron sulfate shall be ferric sulphate or ferrous sulphate in pellet or granular form containing not less than 18.5% iron, expressed as metallic iron, and shall be registered as an agricultural mineral with the State Department of Agriculture in compliance with Article 2 "Fertilizing Materials", Section 1030 of the Agriculture Code.

2.03 SEED:

Table with columns: Turf Seed Mix, Proportion, Purity, Germination. Rows include Perennial Ryegrass, P3 Bluegrass, and Un-Mulched Bermuda.

(Note: For applications in May through September, use Mulched Bermuda.)
Seeding rate: 218 pounds per acre (5 pounds per 1,000 square feet)

2.04 HYDROSEEDING MATERIALS:

- A. Add the following to Standard Specifications Section 212-1.3:
Water: All water used shall be potable domestic water as drawn from the City pressure main. See General Provisions section 7-8.5 regarding temporary construction meter and charges for water drawn from City fire hydrants.
Seed: Turf seed mix as specified.
Mulch: Fiber shall be produced from cellulose such as wood pulp or similar organic material and shall be of such character that it will disperse into a uniform slurry when mixed with water.
Fertilizers:
A. 16-7-12 (+Iron) resin coated prills, Agriform, or City approved equal.
B. Single super phosphate 0-18-0.

2.05 PLANTS:

- A. Add the following to Standard Specifications Section 212-1.4.1:
All plants shall be true to name, and one of each bundle or lot shall be tagged with the name and size of plants in accordance with the standards of practice recommended by the American Association of Nurserymen. The root condition of plants furnished in containers shall be determined by removal of earth from the roots of not less than two plants nor more than 2% of the total number of plants of each species or variety except when container-grown plants are from several different sources; in which case, the roots of not less than two plants of each species or variety from each source shall be checked by the Park Projects Inspector at his option.
B. Amend the Standard Specifications Section 212-1.4.2 and 212-1.4.3:
All trees and shrubs supplied by contractor shall be of the specified standard height and diameter set by the American Standard for Nursery Stock. The height of the trees shall be measured from the crown to the last division of the terminal leader and the diameter shall be measured six (6) inches above the crown roots.
C. Add to Standard Specifications, new Section 212-1.4.6: Rooted cuttings will also be acceptable.
D. Bare root stock shall conform to the American Nurseryman's Association standards. Minimum caliper shall be two (2) inch diameter and minimum height shall be twelve (12) feet.

2.06 BACKFILL MATERIAL:

- A. Add the following to the Standard Specifications Section 212:
Top soil shall be free of noxious weed seed and shall be of a loam characteristic, fertile and friable.
B. Wood shavings shall be leached nitrogen fortified and shall be free of foreign matter.
C. Soil used for backfill of planting pits for container plants shall be enriched using the following blend per cubic yard (agronomic soil test recommendations to be reviewed prior to soil mixing):
60% site soil 3 lbs. gypsum
40% wood shavings 2 lbs. iron sulphate
2 lbs. commercial fertilizer
D. Bare root stock backfill shall consist of 10% wood shavings and 90% site soil with fertilizer and soil conditioners as specified for container plants.
E. All soil backfill shall be bulk mixed, not individually mixed at each plant pit.

2.07 HEADERS, STAKES AND TIES:

- A. Add the following to Standard Specifications Section 212-1.5.3:
(1) Tree stakes shall be straight-grained lodgepole pine, or City approved equal.
(2) Tree ties shall be made from tire casing, 22" long by 3/4" wide, fastened to tree stake with two galvanized sd roofing nails each.
B. Add the following new section to Standard Specifications Section 212-1.5(4): Concrete Curing - Concrete shall be 5 sack mix with a maximum slump test of four inches (4").
C. Add the following to Standard Specifications Section 212-1.5.3:
(1) Tree stakes shall be straight-grained lodgepole pine, or City approved equal.
(2) Tree ties shall be made from tire casing, 22" long by 3/4" wide, fastened to tree stake with two galvanized sd roofing nails each.
D. Add the following new section to Standard Specifications Section 212-1.5(4): Concrete Curing - Concrete shall be 5 sack mix with a maximum slump test of four inches (4").
E. Add the following to Standard Specifications Section 212-1.5.3:
(1) Tree stakes shall be straight-grained lodgepole pine, or City approved equal.
(2) Tree ties shall be made from tire casing, 22" long by 3/4" wide, fastened to tree stake with two galvanized sd roofing nails each.

2.08 JUTE NETTING:

Jute netting shall be new and shall be of uniform, plain-weave, flame-retardant mesh. The mesh shall be dyed green and shall be made from unbleached single jute yarn. The yarn shall be of loosely twisted construction and shall not vary in thickness by more than one-half its normal diameter. Jute netting shall be furnished in rolled strips and shall meet the following requirements:
Width - 48 inches, with a tolerance of one inch wider or narrower.
Minimum 78 warp ends per width of roll.
Minimum 41 weft ends per yard of length.
Weight shall average 1.22 pounds per linear yard, with a tolerance of 5 percent heavier or lighter.

PART 3 - EXECUTION

3.01 GENERAL:

All work shall conform with Section 308 of the Standard Specification, except as modified herein.

3.02 WEED CONTROL MEASURES:

- A. Upon completion of all fine grading work per Section 02210 Grading, and prior to soil preparation, perform weed control measures as follows:
1. Irrigate all areas designated to be planted for a minimum of 10 minutes per setting, two settings per day for seven days to germinate all weed seed possible.

- 2. Apply a contact weed killer and allow sufficient time to obtain complete kill of all weeds germinated.
3. Repeat step one above.
4. Repeat step two above.

3.03 SOIL PREPARATION:

- A. All fine grading and mounding per Section 02210 and weed control measures shall be completed prior to soil preparation.
B. This work shall not commence until the agronomic soils test has been completed.
C. Planting areas with slopes 3:1 and steeper shall not be soil prepared.
D. The following soil amendments shall be added per 1,000 square feet to all planting areas with gradients less than 3:1.

3.04 FINISH GRADING:

The Contractor shall finish grade all planting areas filling as needed or removing surplus dirt, raking to remove all rocks and debris over 1 inch in diameter, and floating to a smooth uniform grade. All areas shall slope to drain. Flow lines shall be established to existing roads, curbs, swales, and/or sidewalks as shown on the plans and as directed. All fill material placed within the top 12" from finish grade elevations in all planting areas shall be topsoil.

3.05 EROSION CONTROL:

Add new section to the Standard Specifications: 308-4.6(f) Jute Netting:
All slopes areas exceeding 3:1 shall receive jute netting. Netting shall also be provided during the maintenance period, when and as directed by the Park Projects Inspector, along flow lines and other locations where erosion is evident.
3.06 PLANTING:

- A. Amend the Standard Specifications Section 308-4.5 to coordinate with Section 2.06 herein for specified backfill mix.
B. Add the following to the Standard Specifications Section 308-4.5:
(1) Soil surrounding planting pit shall be in a friable condition and moist to a depth of 8".
(2) Backfill using specified soil mix to within 8" of finish grade.
C. Add the following to Standard Specifications Section 308-4.7:
(1) On slopes exceeding 3:1 ratio, apply 5 gram Agriform tablets, one per plant in lieu of soil preparation work.
(2) Mulch and fertilize groundcover areas using 1.5 cubic yards of wood shavings and 5 lbs. of the specified commercial fertilizer per 1,000 square feet.

3.07 TREE STAKING:

Amend the Standard Specifications Section 308-4.6.1 and 308-4.6.2 to read: Stake trees per Park and Recreation Department standard detail.

3.08 TURF PLANTING:

Add the following to Standard Specifications Section 308-4.8.2, b:
Mixing of hydroseed slurry: Mixing shall be performed in a tank, with a built-in continuous agitation and recirculation system of sufficient operating capacity to produce a homogeneous slurry of fiber, M-binder, seed, fertilizer and water in the designated unit proportions.
Fiber 1,000 lbs./acre
Fertilizers:
MPC 870 lbs./acre
Single superphosphate 200 lb./acre
Seed as specified in Section 2.03
M-Binder 100 lbs./acre on slopes exceeding 5:1
Water 3,000 gal./acre
Agricultural Grade Gypsum 500 lb./acre
With agitation system operating at partial speed, water shall be added to the tank, good recirculation shall be established. Materials shall be added in such a manner that they are uniformly blended into the mixture in the following sequence:
When tank is 1/3 filled with water:
Add binding agent - 1/2 acre requirement.
Add 3 - 50 pound bales of fiber.
Add seed - 1/2 acre requirement.
Add fertilizer - 1/2 acre requirement.

Agitate mixture at full speed when the tank is half-filled with water.
Add remainder fiber requirement, 7 bales before tank is 3/4 full. Add remainder fertilizers, seed and gypsum. Slurry distribution should begin immediately.
Area to be hydroseeded shall be moistened to a depth of six inches just prior to application.

Application: Hydroseed slurry shall be applied under high pressure evenly and result in a uniform coat on all areas to be treated. Care shall be exercised to assure that plants in place are not subjected to the direct force of the application. Slurry shall be immediately removed from walks, structures, plants, etc., that are inadvertently covered.
All bare spots shall be reseeded by the Contractor within 10 days. The Contractor shall be responsible for all reseeded areas for as long after seeding as necessary until acceptable germination and establishment is realized and approved by the City.
The slurry shall not be sprayed on undesignated areas. Any slurry spilled or sprayed into areas other than those designated to receive slurry shall be cleaned up at the Contractor's expense to the satisfaction of the City.

3.09 WATERING:

- A. It shall be the Contractor's responsibility to maintain a balanced watering program to ensure proper growth until final acceptance of the work.
B. Immediately after planting, apply water to each plant.
C. Apply water in sufficient quantities and as often as seasonal conditions require to keep the planted areas moist at all times, well below the root system of plants.
D. Irrigation:
(1) Contractor shall properly and completely maintain the irrigation system.
(2) All controllers are to have each station individually adjusted on a weekly basis.

3.10 MAINTENANCE:

Amend the Standard Specifications Section 308-6 to read: All areas within the work limits of this contract shall be maintained by the contractor for the duration of the contract until final acceptance.

3.11 START OF PLANT ESTABLISHMENT:

- A. Criteria for Start of Plant Establishment Period:
(1) The plant establishment period shall not start until all elements of the project that impact the landscape are completed in accordance with the contract documents.
(2) Permanent power to remote controllers shall be established.
(3) The plant establishment period for the project shall not begin until after the first mowing of the newly planted turf areas.
(4) Written acceptance of the City must be obtained to start the plant establishment period.
(5) If the project maintenance fails to continuously meet standards required, the plant establishment period "may count" will be suspended and will not recommence until the Contractor has corrected all deficiencies.

3.12 MAINTENANCE TASKS:

- A. General:
During the contract period provide all watering, weeding, mowing, fertilizing and cultivation and spraying necessary to keep the plants and turf in a healthy growing condition and to keep the planted areas neat, tidy, and attractive.
B. Iron Chlorosis:
After planting and during the plant establishment period, in the event that any plantings exhibit iron chlorosis symptoms, apply Fe 138 Gel or equivalent at manufacturer's recommended rates.
C. Replacement Plantings:
During the plant establishment period, should the appearance of any planting installed by the contractor indicate weakness, that plant shall be replaced immediately with a new, healthy plant.
D. Fertilization:
The Contractor shall apply commercial fertilizer to all turf areas at a rate of 5 pounds per 1,000 square feet, at 30-day intervals, for 3 applications as a minimum, above and beyond the original soil preparation application.
E. Planting Establishment:
All planting areas that do not show a prompt establishment of plant material shall be replanted at 10-day intervals until the plant material is established.
F. Grading and Drainage:
During the plant establishment period all flow lines shall be maintained to allow for free flow of surface water.

(1) Damage to planting areas shall be repaired immediately and throughout the plant establishment period. Depressions caused by vehicles, bicycles, or foot traffic shall be filled and leveled. Replant damaged areas.

- (2) All paved areas shall be washed and maintained in a neat and clean condition at all times.
(3) All subsurface drains and inlets shall be periodically cleared of debris, leaves and trash and flushed with clear water to avoid build up of silt and debris.
(4) Debris and trash shall be removed from the site weekly at a minimum.

G. Disease and Pest Control:

Add the following to Standard Specifications Section 308-6: Throughout the plant establishment period, all plants shall be maintained in a disease and pest free condition. A licensed pest control operator shall be retained by the Contractor to recommend and apply all pesticides, herbicides, and fungicides. Exterminate gophers, moles, and all other rodents, and repair damage.

3.13 END OF PLANT ESTABLISHMENT PERIOD:

- A. When the contractor believes he has completed the plant establishment period and the entire project is ready for final acceptance, he shall request inspection of the project.
B. All planting areas shall show a good rate of growth and shall be well established.
C. Final acceptance shall occur only upon written acceptance of the project for maintenance by the City.

3.14 CLEAN UP:

Upon completion of the work, the Contractor shall smooth all ground surfaces; remove excess materials, rubbish, debris, etc.; sweep adjacent streets, curbs, gutters; wash down all walkways, and trails; and remove construction equipment from the premises.

END OF SECTION

8/3/0020/c
06/28/88



ORTON associates
landscape development
LICENSE NO 1214 (714) 985-7000
607 e. seventh st. • upland • ca 91786

Table with columns: APPROVED BY, DATE, BY, PUBLIC WORKS DIRECTOR. Includes signature of Barry Best and date 12/19/88.

CITY OF RIVERSIDE
PUBLIC WORKS DEPARTMENT
SPECIFICATION SHEET
MISSION GROVE PARKWAY
FOR
TRACT 22212

ACCOUNT NO.
R-2970L
SHEET 3 OF 4

