


CITY OF RIVERSIDE


City of Riverside  
Building & Safety Division

DISABLED ACCESS STANDARDS

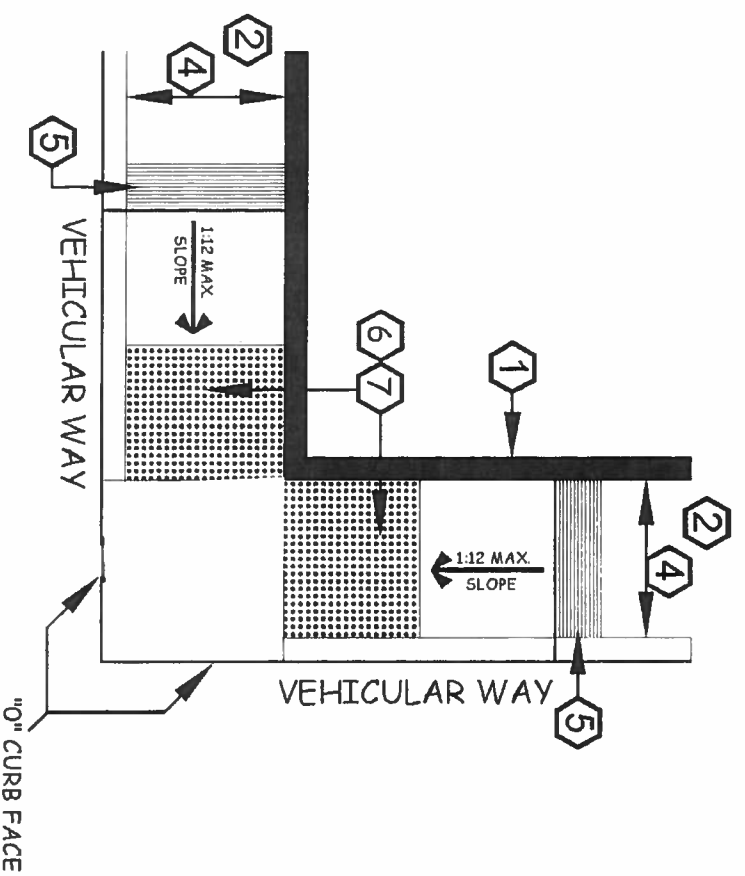


INTERSECTING CURB RAMPS AT VEHICULAR WAYS

A

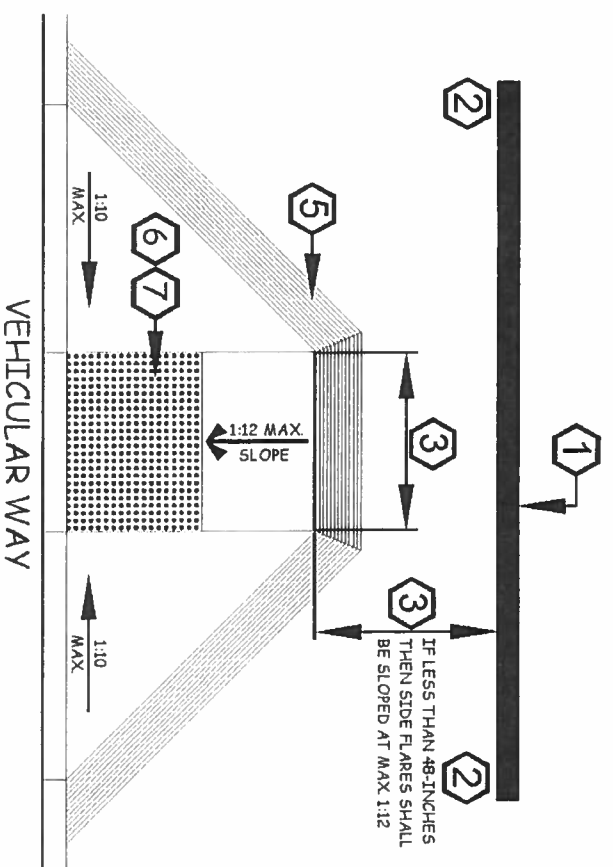


CURB RAMP PERPENDICULAR TO VEHICULAR WAY

B

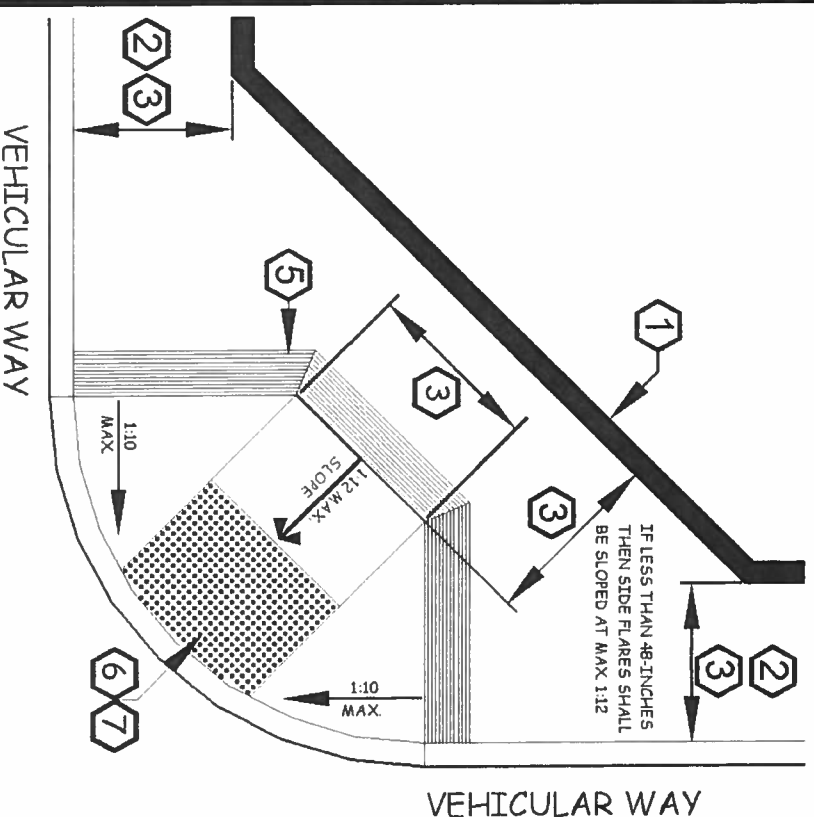

DIAGONAL CURB RAMP AT VEHICULAR WAYS

C

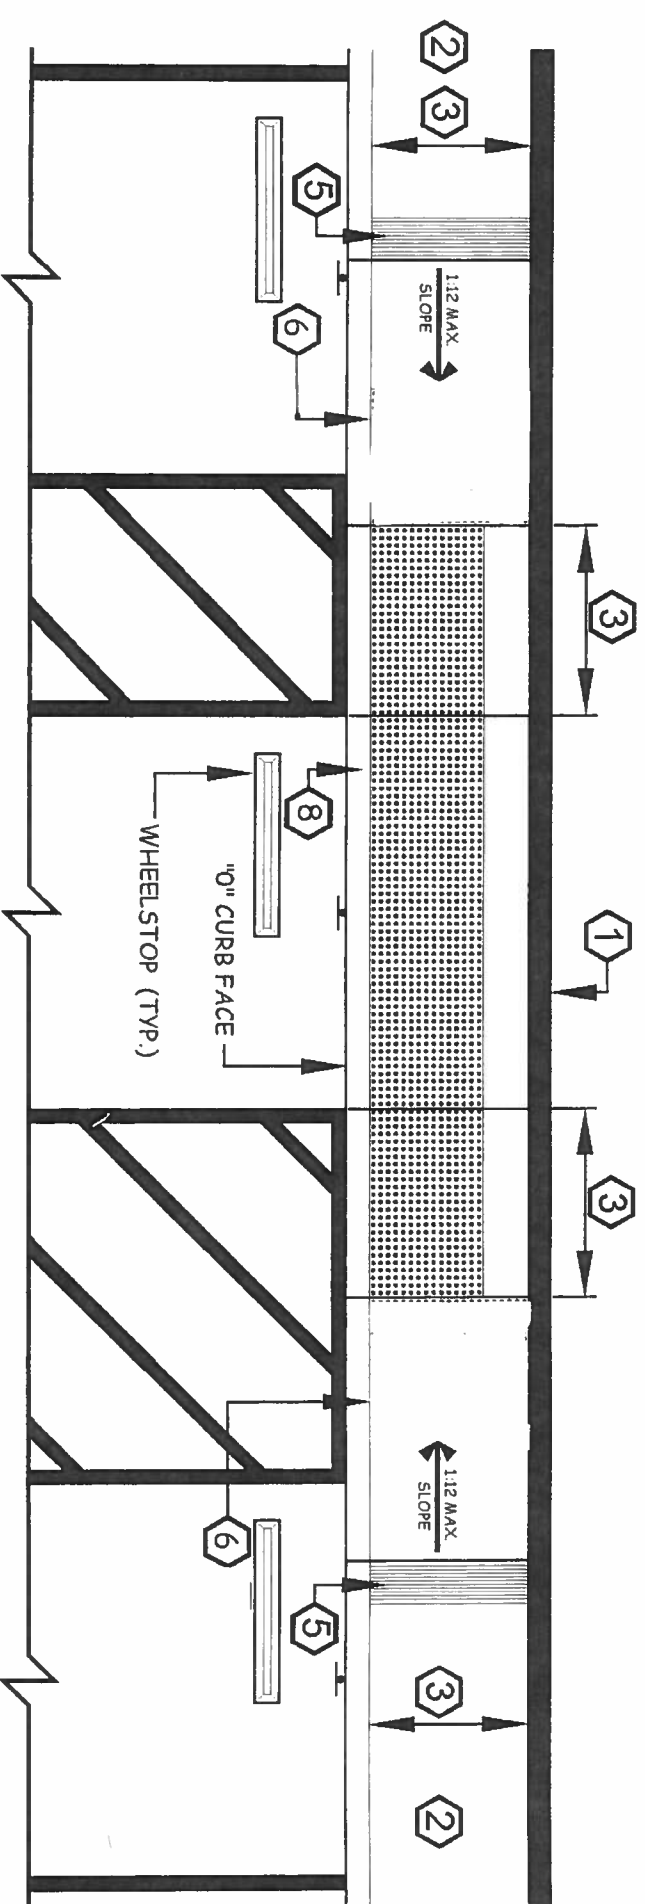

CURB RAMPS @ ACCESSIBLE PARKING AREAS

D

**KEYNOTES**

- 1 WALL, FENCE, LANDSCAPING OR OTHER OBSTRUCTION.
  - 2 ACCESSIBLE ROUTE OF PEDESTRIAN TRAVEL.
  - 3 48-INCH MINIMUM
  - 4 MAY BE LESS THAN 60-INCHES BUT NOT LESS THAN 48-INCHES.
  - 5 12-INCH MINIMUM BORDER GROOVES @ 3/4-INCH O/C. GROOVES MUST BE POSITIONED ON THE LEVEL SURFACE AT THE TOP OF THE CURB RAMP. \*
  - 6 SLOPE OF CURB RAMPS SHALL NOT EXCEED (1) UNIT VERTICAL TO (12) UNITS HORIZONTAL (1:12 or 8.33%).
  - 7 TRUNCATED DOMES SHALL EXTEND 36 INCHES MINIMUM IN THE DIRECTION OF TRAVEL FOR THE FULL WIDTH OF CURB RAMP, EXCLUDING THE FLARED SIDES.
  - 8 A MINIMUM 36-INCH WIDE SECTION OF TRUNCATED DOMES SHALL BE PROVIDED WHEN FLAT TRAVEL SURFACE ADJOINS A VEHICULAR WAY ("0" CURB FACE).
- \* BORDER GROOVES AT TOP OF RAMP ARE NO LONGER REQUIRED

E

SCALE	NONE	
PGH	01 / 08	
DATE		
REV	DATE	APP
1	01-01-11	PGH
2	08-01-12	PGH
3	12/16/14	DJD
4		
5		

DETECTABLE  
WARNINGS @  
CURB RAMPS

RDA - 8.0  
SHEET