



VAULT RACK SUPPORTS OVER DEEP RECESSES

RIVERSIDE PUBLIC UTILITIES DEPT.- UNDERGROUND STRUCTURES

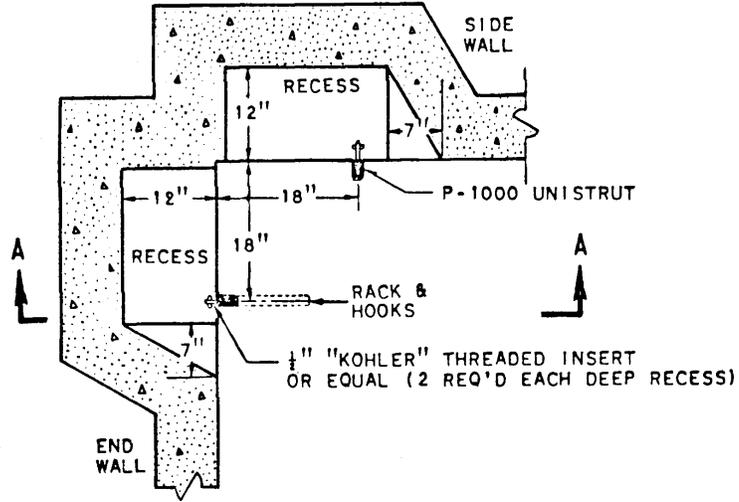

PLAN

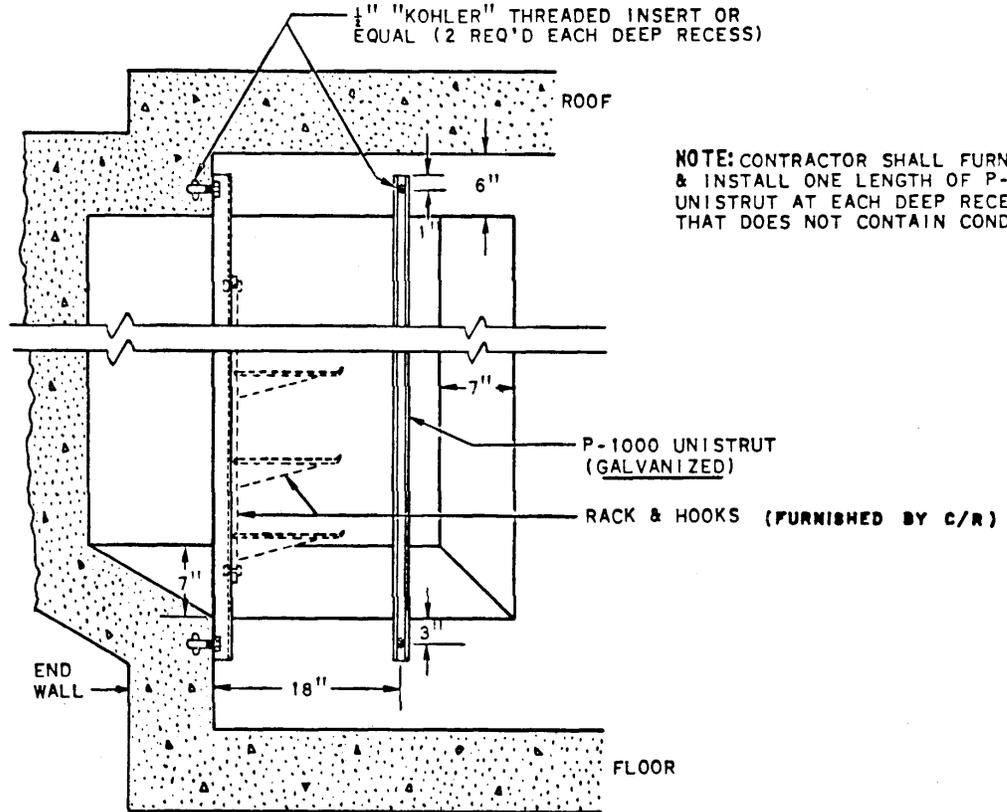

NOTE: CONTRACTOR SHALL FURNISH & INSTALL ONE LENGTH OF P-1000 UNISTRUT AT EACH DEEP RECESS THAT DOES NOT CONTAIN CONDUIT.

SECTION "A-A"