



PLASTIC CONDUIT "Y" FITTINGS

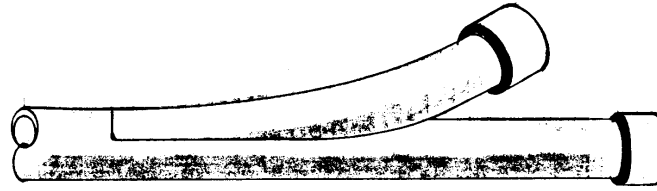

"Y" fittings are available in two types - the one piece "Y" (for new installations) and the split "Y" (for existing installations). Install "Y" fittings only when called out on the working drawing.


INSTALLATION EXAMPLES

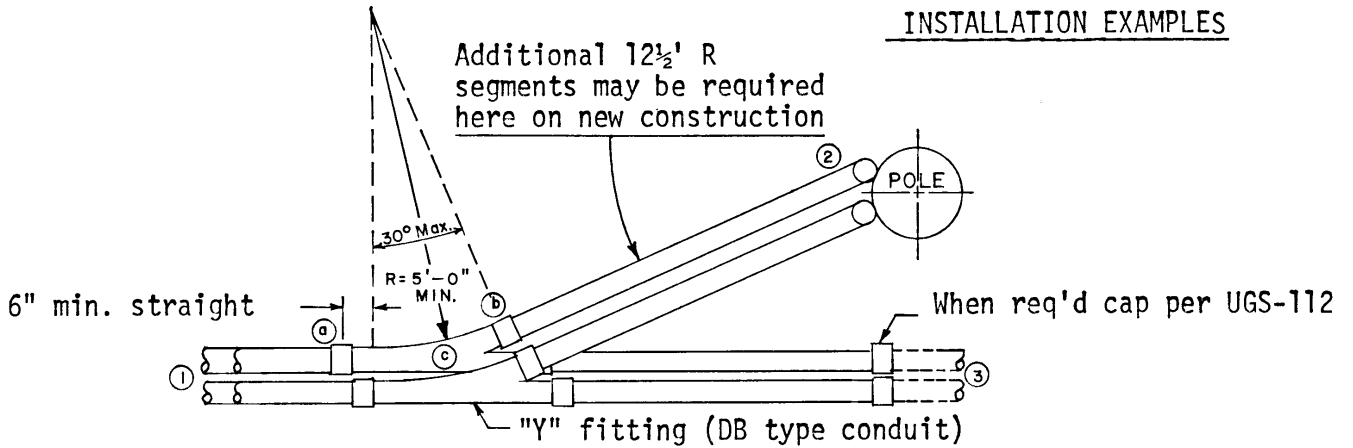

METHOD 1

All notes on Method 1 typical for Method 2

"Y" fittings stacked

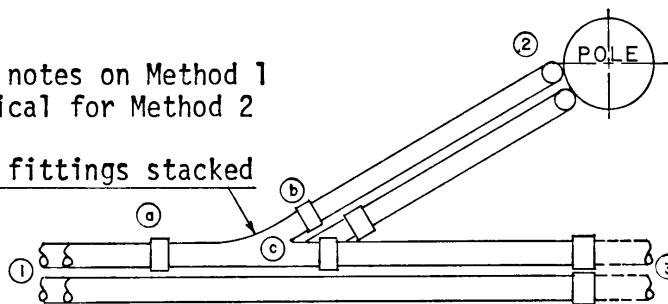

METHOD 2

METHOD: Use Method 1 or 2 as specified on working drawings.

NEW INSTALLATIONS: When installing one piece "Y" fittings, mandrell all conduits and install approved pull ropes in conduit from ① to ②.

EXISTING INSTALLATIONS: When installing split "Y" fittings, carefully remove existing conduit (see note) from (a) to (b). Tie approved pull rope to cables at (c) and extend to ③. Place split "Y" around cables and tape together. Cement couplings to existing conduit and install split "Y" fitting. Encase in concrete for watertight seal.

NOTE: Contact Public Utilities Department Construction Inspector prior to working on or near conduits that contain energized cables. Phone 787-7421.

Approved Manufacturers: Carlon Products Corp.
R. W. Johnson, Inc.
Vimar, Inc.

RIVERSIDE PUBLIC UTILITIES DEPT. UNDERGROUND STRUCTURES

J. H. Campbell
CHIEF UTILITY ENGINEER

LATEST REVISION: REDRAWN